



**CLEAN DEVELOPMENT MECHANISM  
PROJECT DESIGN DOCUMENT FORM (CDM-PDD)  
Version 03 - in effect as of: 28 July 2006**

**CONTENTS**

- A. General description of project activity
- B. Application of a baseline and monitoring methodology.
- C. Duration of the project activity / crediting period
- D. Environmental impacts
- E. Stakeholders' comments

**Annexes**

- Annex 1: Contact information on participants in the project activity
- Annex 2: Information regarding public funding
- Annex 3: Baseline information
- Annex 4: Monitoring plan
- Appendix 1: Location Map
- Appendix 2: Minutes of local stakeholder meeting

**SECTION A. General description of project activity****A.1 Title of the project activity:**

&gt;&gt;

Title: Enercon Wind Farm (Hindustan) Ltd in Rajasthan

Version: 5.0

Date of completion of PDD: 05/10/2007

**A.2. Description of the project activity:**

&gt;&gt;

**Objective of the Project**

The objective is development, design, engineering, procurement, finance, construction, operation and maintenance of Enercon Wind Farm (Hindustan) Ltd. 60 MW wind power project (“Project”) in the Indian state of Rajasthan to provide reliable, renewable power to the Rajasthan state electricity grid which is part of the Northern regional electricity grid. The Project will lead to reduced greenhouse gas emissions because it displaces electricity from fossil fuel based electricity generation plants.

**Nature of Project**

The Project harness renewable resources in the region, and thereby displacing non-renewable natural resources thereby ultimately leading to sustainable economic and environmental development. Enercon (India) Ltd (“Enercon” or “EIL”) will be the equipment supplier and the operations and maintenance contractor for the Project. The generated electricity will be supplied to Rajasthan Rajya Vidyut Prasaran Nigam Ltd (“RRPVN”)/ Jodhpur Electricity Distribution Company Ltd (“Jodhpur Discom”) under a long-term power purchase agreement (PPA). The Project is owned by Enercon (India) Ltd and Enercon GmbH.

**Contribution to sustainable development**

The Project meets several sustainable development objectives including:

- contribution towards the policy objectives of Government of India and Government of Rajasthan of incremental capacity from renewable sources;
- contribution towards meeting the electricity deficit in Rajasthan;
- CO<sub>2</sub> abatement and reduction of greenhouse gas emissions through development of renewable technology;
- reducing the average emission intensity (SO<sub>x</sub>, NO<sub>x</sub>, PM, etc.), average effluent intensity and average solid waste intensity of power generation in the system;
- conserving natural resources including land, forests, minerals, water and ecosystems; and
- developing the local economy and create jobs and employment, particularly in rural areas, which is a priority concern for the Government of India;

**A.3. Project participants:**



&gt;&gt;

Name of Party involved ((host) indicates a host Party)	Private and/or public entity(ies) project participants (*) (as applicable)	Kindly indicate if the Party involved wishes to be considered as project participant (Yes/No)
Government of India (Host)	Enercon (India) Ltd	No
Government of UK	Coöperatieve Centrale Raiffeisen-Boerenleenbank B.A.	No

The contact details of the entities are provided in Annex – 1.

#### A.4. Technical description of the project activity:

##### A.4.1. Location of the project activity:

&gt;&gt;

##### A.4.1.1. Host Party(ies):

&gt;&gt;

The host party to the project activity is the Government of India.

##### A.4.1.2. Region/State/Province etc.:

&gt;&gt;

The Project is located in the State of Rajasthan that forms part of the Northern regional electricity grid of India.

##### A.4.1.3. City/Town/Community etc:

&gt;&gt;

The Project is located at Kita and BHU village, in Jaisalmer District of Rajasthan state in India.

##### A.4.1.4. Detail of physical location, including information allowing the unique identification of this project activity (maximum one page):

&gt;&gt;

The project area extends between latitude 26° 41' & 26° 41.5' North and longitude 70° 57.5' & 71° 4' East. The Project is connected to 33/132/220 kV Amarsagar RRVN substation. The sites are located at a distance of 25 km from Jaisalmer by road. The nearest railway station is at Jaisalmer. A location map is attached at Appendix – 1.

##### A.4.2. Category(ies) of project activity:

&gt;&gt;

The project activity is considered under CDM category zero-emissions '**grid-connected electricity generation from renewable sources**' that generates electricity in excess of 15 MW (limit for small scale project). Therefore as per the scope of the project activity enlisted in the 'list of sectoral scopes and related approved baseline and monitoring methodologies (version 02 Mar 05/07:23)', the project activity may principally be categorized in Scope Number 1, Sectoral Scope - Energy industries (renewable/ non-renewable sources).

**A.4.3. Technology to be employed by the project activity:**

&gt;&gt;

The Project involves 75 wind energy converters (WECs) of Enercon make (800 kW E-48) with internal electrical lines connecting the Project with local evacuation facility. The WECs generates 3-phase power at 400V, which is stepped up to 33 KV. The Project can operate in the frequency range of 47.5–51.5 Hz and in the voltage range of 400 V  $\pm$  12.5%. The other salient features of the state-of-art-technology are:

- Gearless Construction - Rotor & Generator Mounted on same shaft eliminating the Gearbox.
- Variable speed function – has the speed range of 18 to 33 RPM thereby ensuring optimum efficiency at all times.
- Variable Pitch functions ensuring maximum energy capture.
- Near Unity Power Factor at all times.
- Minimum drawl (less than 1% of kWh generated) of Reactive Power from the grid.
- No voltage peaks at any time.
- Operating range of the WEC with voltage fluctuation of -20 to +20%.
- Less Wear & Tear since the system eliminates mechanical brake, which are not needed due to low speed generator which runs at maximum speed of 33 rpm and uses Air Brakes.
- Three Independent Braking System.
- Generator achieving rated output at only 33 rpm.
- Incorporates lightning protection system, which includes blades.
- Starts Generation of power at wind speed of 3 m/s.

Enercon (India) Ltd has secured and facilitated the technology transfer for wind based renewable energy generation from Enercon GmbH, has established a manufacturing plant at Daman in India, where along with other components the "Synchronous Generators" using "Vacuum Impregnation" technology are manufactured.

**A.4.4 Estimated amount of emission reductions over the chosen crediting period:**

&gt;&gt;

Crediting Period for the Project: fixed for 10 years

Years	Annual estimation of emission reductions in tonnes of CO <sub>2</sub> e
15Aug2007-31Mar2008	63,154
01Apr2008-31Mar2009	101,047
01Apr2009-31Mar-2010	101,047
01Apr2010-31Mar2011	101,047
01Apr2011-31Mar2012	101,047
01Apr2012-31Mar2013	101,047
01Apr2013-31Mar2014	101,047
01Apr2014-31Mar2015	101,047
01Apr2015-31Mar2016	101,047



Years	Annual estimation of emission reductions in tonnes of CO <sub>2</sub> e
01Apr2016-31Mar2017	101,047
01Apr2017-14Aug2017	37,893
Total estimated reductions (tonnes of CO <sub>2</sub> e)	1,010,470
Total number of crediting years	10
Annual average over the crediting period of estimated reductions (tonnes of CO <sub>2</sub> e)	101,047

#### **A.4.5. Public funding of the project activity:**

&gt;&gt;

There is no ODA financing involved in the Project.

### **SECTION B. Application of a baseline and monitoring methodology**

#### **B.1. Title and reference of the approved baseline and monitoring methodology applied to the project activity:**

&gt;&gt;

The approved consolidated baseline and monitoring methodology **ACM0002 Version 6.0** (19 May 2006) has been used. The titles of these baseline and monitoring methodologies are “Consolidated baseline methodology for grid-connected electricity generation from renewable sources” and “Consolidated monitoring methodology for grid-connected electricity generation from renewable sources.”

#### **B.2 Justification of the choice of the methodology and why it is applicable to the project activity:**

&gt;&gt;

The Project is wind based renewable energy source, zero emission power project connected to the Rajasthan state grid, which forms part of the Northern regional electricity grid. The Project will displace fossil fuel based electricity generation that would have otherwise been provided by the operation and expansion of the fossil fuel based power plants in Northern regional electricity grid.

The approved consolidated baseline and monitoring methodology ACM0002 Version 6 is the choice of the baseline and monitoring methodology and it is applicable because:

- the Project is grid connected renewable power generation project activity
- the Project represents electricity capacity additions from wind sources
- the Project does not involve switching from fossil fuel to renewable energy at the site of project activity since the Project is green-field electricity generation capacities from wind sources at sites where there was no electricity generation source prior to the Project, and
- the geographical and system boundaries of the Northern electricity grid can be clearly identified and information on the characteristics of the grid is available.

**B.3. Description of the sources and gases included in the project boundary**

&gt;&gt;

According to ACM0002, for the baseline emission factor, the spatial extent of the project boundary includes the project site and all power plants connected physically to the electricity system that the CDM project power plant is connected to.

The Indian electricity system is divided into five regional grids, viz. Northern, Eastern, Western, Southern, and North-Eastern. Each grid covers several states. As the regional grids are interconnected, there is inter-state and inter-regional exchange. A small power exchange also takes place with neighbouring countries like Bhutan and Nepal.

The project boundary encompasses the physical extent of the northern regional electricity grid which includes the project site and all power plants connected physically to the electricity system.

Power generation and supply within the regional grid is managed by Regional Load Dispatch Centre (RLDC). The Regional Power Committees (RPCs) provide a common platform for discussion and solution to the regional problems relating to the grid. Each state in a regional grid meets its demand with its own generation facilities and also with allocation from power plants owned by the Central Sector such as NTPC and NHPC etc. Specific quotas are allocated to each state from the Central Sector power plants. Depending on the demand and generation, there are electricity exports and imports between states in the regional grid. The regional grid thus represents the largest electricity grid where power plants can be dispatched without significant constraints and thus, represents the “project electricity system” for the Project. As the Project is connected to the Northern regional electricity grid, the Northern grid is the “project electricity system”.

	Source	Gas	Included?	Justification/ Explanation
<b>Baseline</b>	Electricity generation from power plants connected to the Northern Grid	CO <sub>2</sub>	Included	Main emission source
		CH <sub>4</sub>	Excluded	This source is not required to be estimated for wind energy projects under ACM0002
		N <sub>2</sub> O	Excluded	This source is not required to be estimated for wind energy projects under ACM0002
<b>Project Activity</b>	Electricity generation from the Project	CO <sub>2</sub>	Excluded	Wind energy generation does not have any direct GHG emissions.
		CH <sub>4</sub>	Excluded	
		N <sub>2</sub> O	Excluded	

**B.4. Description of how the baseline scenario is identified and description of the identified baseline scenario:**

&gt;&gt;

According to ACM0002, for project activities that do not modify or retrofit an existing electricity generation facility, the baseline scenario is the following:




*Electricity delivered to the grid by the project would have otherwise been generated by the operation of grid-connected power plants and by the addition of new generation sources, as reflected in the combined margin (CM) calculations described below.*

As the Project does not modify or retrofit an existing generation facility, the baseline scenario is the emissions generated by the operation of grid-connected power plants and by the addition of new generation sources. This is estimated using calculation of Combined Margin multiplied by electricity delivered to the grid by the Project.

**B.5. Description of how the anthropogenic emissions of GHG by sources are reduced below those that would have occurred in the absence of the registered CDM project activity (assessment and demonstration of additionality): >>**

The latest additionality tool i.e. Tool for the demonstration and assessment of additionality version 3.0 approved by CDM Executive Board in its 29th meeting is used to demonstrate project additionality.

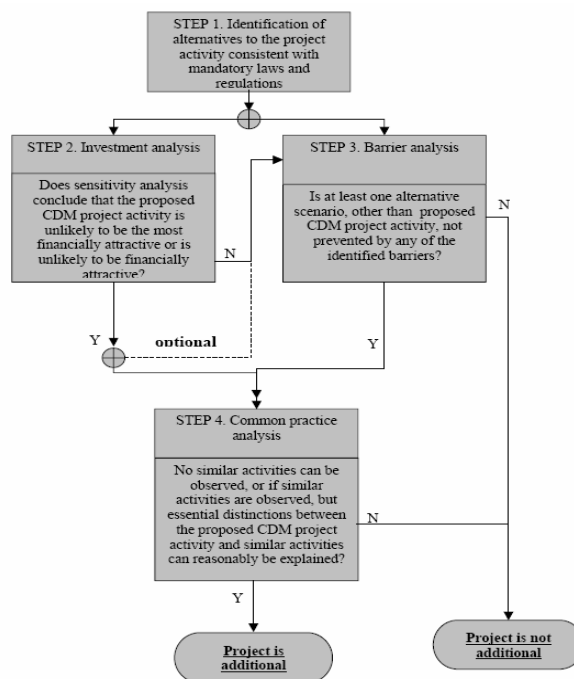

The Project start date is prior to the date of validation of the PDD. Enercon entered into an Emission Reduction Purchase Agreement dated 7 December 2005 with a CER purchaser for purchase of emission reductions from the Project, which is prior to the start date of the Project.

**Step 1: Identification of alternatives to the project activity consistent with current laws and regulations**

Define realistic and credible alternatives to the project activity(s) that can be (part of) the baseline scenario through the following sub-steps:

**Sub-step 1a. Define alternatives to the project activity:**



1. Identify realistic and credible alternative(s) available to the project participants or similar project developers that provide outputs or services comparable with the proposed CDM project activity. These alternatives are to include:

- The proposed project activity undertaken without being registered as a CDM project activity;
- Other realistic and credible alternative scenario(s) to the proposed CDM project activity scenario that deliver outputs and on services (e.g. electricity, heat or cement) with comparable quality, properties and application areas; taking into account, where relevant, examples of scenarios identified in the underlying methodology;
- If applicable, continuation of the current situation (no project activity or other alternatives undertaken).

Alternative(s) available to the project participants or similar project developers include:

- (a) The Project is undertaken without being registered as a CDM project activity.
- (b) Setting up of comparable utility scale fossil fuel fired or hydro power projects that supply to the Rajasthan grid under a PPA.
- (c) Continuation of the current situation where no project activity or any of the above Alternatives are undertaken would not be applicable as Rajasthan had energy (MU) shortages of 3.5% and peak (MW) shortages of 13.7% in 2005-06 (Source: Northern Region Power Sector Profile, July 2006, Ministry of Power).

#### ***Sub-step 1b. Enforcement of applicable laws and regulations***

2. The alternative(s) shall be in compliance with all mandatory applicable legal and regulatory requirements, even if these laws and regulations have objectives other than GHG reductions, e.g. to mitigate local air pollution. (This sub-step does not consider national and local policies that do not have legally-binding status.)
3. If an alternative does not comply with all mandatory applicable legislation and regulations, then show that, based on an examination of current practice in the country or region in which the law or regulation applies, those applicable legal or regulatory requirements are systematically not enforced and that non-compliance with those requirements is widespread in the country. If this cannot be shown, then eliminate the alternative from further consideration.
4. If the proposed project activity is the only alternative amongst the ones considered by the project participants that is in compliance with mandatory regulations with which there is general compliance, then the proposed CDM project activity is not additional.

There are no legal and regulatory requirements that prevent Alternatives (a) and (b) from occurring.

***Proceed to Step 2 (Investment analysis) or Step 3 (Barrier analysis). (Project participants may also select to complete both steps 2 and 3.)***

#### **Step 2: Investment analysis**

Determine whether the proposed project activity is economically or financially less attractive than at least one other alternatives identified in step 1, without the revenue from the sale of certified emission reductions (CERs). To conduct the investment analysis, use the following sub-steps:





#### Sub-step 2a. - Determine appropriate analysis method

1. Determine whether to apply simple cost analysis, investment comparison analysis or benchmark analysis (sub-step 2b). If the CDM project activity generates no financial or economic benefits other than CDM related income, then apply the simple cost analysis (Option I). Otherwise, use the investment comparison analysis (Option II) or the benchmark analysis (Option III).

#### Sub-step 2b. – Option I. Apply simple cost analysis

2. Document the costs associated with the CDM project activity and demonstrate that the activity produces no economic benefits other than CDM related income.

#### Sub-step 2b. – Option II. Apply investment comparison analysis

3. Identify the financial indicator, such as IRR, NPV, cost benefit ratio, or unit cost of service (e.g., levelized cost of electricity production in \$/kWh or levelized cost of delivered heat in \$/GJ) most suitable for the project type and decision-making context.

#### Sub-step 2b. – Option III. Apply benchmark analysis

4. Identify the financial indicator, such as IRR, NPV, cost benefit ratio, or unit cost of service (e.g., levelized cost of electricity production in \$/kWh or levelized cost of delivered heat in \$/GJ) most suitable for the project type and decision context.

Option I – Simple cost analysis is not applicable as the project activity sells electricity to the grid and obtains economic benefits in the form of electricity tariffs.

Enercon proposes to use **Option III – Benchmark analysis** and the financial indicator that is identified is the post-tax return on equity or the equity IRR.

The post tax return on equity and equity IRR is used as the appropriate financial indicator because in the Indian power sector, a 14% post tax return on equity is an established benchmark for projects in public or private sector based on cost-plus regulations (Source: Central Electricity Regulatory Commission, Terms and Conditions of Tariff, Regulations 2004 dated 26 March 2004) for utility scale power plants (similar to Alternative (b)). Incentives, foreign exchange variations and efficiency in operations are in addition to this benchmark of 14%.

For determining the tariffs for wind power projects, the electricity regulatory commissions of the state of Rajasthan and Gujarat have considered the return on equity at 14% while the electricity regulatory commissions of the state of Madhya Pradesh, Maharashtra and Karnataka have considered the return on equity at 16%. (Source: RERC Order dated 29 September 2006).

There are some essential differences between the Project (whether implemented with or without CDM revenues) and the Alternatives identified in Sub-step 1(b) (utility scale fossil fuel and hydro projects). These should be taken into account while setting the appropriate level of equity IRR.

- The project activity tariff structure is a single-part tariff structure as compared to utility scale fossil fuel and hydro projects, which have two-part tariff structure. This implies that project activity carries a higher investment risk than the utility scale fossil fuel and hydro projects (Alternative (b)) where the investment recovery is decoupled from the level of actual generation achieved by the project due to variations in offtake.

Thus, in case of the project activity, issues such as transmission unavailability, back-down of generation or part-load operations, which are beyond the control of the investors are likely to affect



the project activity more severely and therefore the project activity investors would require higher rate of return to compensate them for these additional risks.

- In case of utility scale fossil fuel and hydro projects (Alternative (b)), these are by reference to cost-plus approach whereby the projects recover their full investment cost each year if they are able to reach specified level of plant availability. In case of the Project, it does not recover its full investment cost in the initial years as the tariffs are back-loaded. This increases the investment risks in the project activity compared to the alternatives.

Based on the above considerations, 16% post-tax equity IRR is considered to be the appropriate post-tax equity return. If the Project has a post-tax equity IRR of less than 16%, then it can be considered to be additional.

***Sub-step 2c. Calculation and comparison of financial indicators (only applicable to options II and III):***

5. Calculate the suitable financial indicator for the proposed CDM project activity and, in the case of Option II above, for the other alternatives. Include all relevant costs (including, for example, the investment cost, the operations and maintenance costs), and revenues (excluding CER revenues, but including *inter alia* subsidies/fiscal incentives, ODA, etc, where applicable), and, as appropriate, non-market cost and benefits in the case of public investors.
6. Present the investment analysis in a transparent manner and provide all the relevant assumptions, preferably in the CDM-PDD, or in a separate annexes to the PDD, so that a reader can reproduce the analysis and obtain the same results. Refer to all critical techno-economic parameters and assumptions (such as capital costs, fuel prices, lifetimes, and discount rate or cost of capital). Justify and/or cite assumptions in a manner that can be validated by the DOE. In calculating the financial indicator, the project's risks can be included through the cash flow pattern, subject to project-specific expectations and assumptions (e.g. insurance premiums can be used in the calculation to reflect specific risk equivalents).
7. Assumptions and input data for the investment analysis shall not differ across the project activity and its alternatives, unless differences can be well substantiated.
8. Present in the CDM-PDD submitted for validation a clear comparison of the financial indicator for the proposed CDM activity and:
  - (a) The alternatives, if Option II (investment comparison analysis) is used. If one of the other alternatives has the best indicator (e.g. highest IRR), then the CDM project activity can not be considered as the most financially attractive;
  - (b) The financial benchmark, if Option III (benchmark analysis) is used. If the CDM project activity has a less favourable indicator (e.g. lower IRR) than the benchmark, then the CDM project activity cannot be considered as financially attractive.

The key assumptions used for calculating the benchmark (post-tax equity IRR) are set out below:

Capacity of Machines in kW	800
Number of Machines	75
Project Capacity in MW	60.00
Project Commissioning Date	1-Apr-07
Project Cost per MW (Rs. In Millions)	47.4



## CDM – Executive Board

page 11

Operations	
Plant Load Factor	22.00%
Insurance Charges @ % of capital cost	0.18%
Operation & Maintenance Cost base year @ % of capital cost	1.25%
% of escalation per annum on O & M Charges	5.0%

Tariff	
Base year Tariff (2005-06) - Rs./Kwh	3.25
Annual Escalation (Rs./kWh per Year)	0.06
Tariff applicable from 2014-15 onwards (Rs/kWh)	3.79

Project Cost	Rs Million
Land and Infrastructure, Generator & Electrical Equipments, Mechanical Equipments, Civil Works, Instrumentation & Control, Other Project Cost, Pre operative Expenses, etc.	
Total Project Cost	2,845

Means of Finance		Rs Million
Own Source	30%	854
Term Loan	70%	1,992
Total Source		2,845
Terms of Loan		
Interest Rate	8.50%	
Tenure	10	Years
Moratorium	6	Months

Income Tax Depreciation Rate (Written Down Value basis)	
on Wind Energy Generators	80%
On other Assets	10%
Book Depreciation Rate (Straight Line Method basis)	
On all assets	7.86%
Book Depreciation up to (% of asset value)	90%

Income Tax	
Income Tax rate	30%
Minimum Alternate Tax	10%
Surcharge	10%
Cess	2%



## CDM – Executive Board

page 12

Working capital	
Receivables (no of days)	45
O & m expenses (no of days)	30
Working capital interest rate	12%

CER Revenues	
CER Price in US\$	-
Exchange rate Rs./US\$*	43.59

\* RBI reference rate as of 30 March 2007

Crediting period starts	1-June-07
Length of Crediting period	10

Baseline Emission Factor for Northern Region (tCO2/GWh)	873.87
---	--------

The equity IRR for the Project without CDM revenues is 11.9% and with CDM revenues is 14.6%.

***Sub-step 2d. Sensitivity analysis (only applicable to options II and III):***

9. Include a sensitivity analysis that shows whether the conclusion regarding the financial attractiveness is robust to reasonable variations in the critical assumptions. The investment analysis provides a valid argument in favour of additionality only if it consistently supports (for a realistic range of assumptions) the conclusion that the project activity is unlikely to be the most financially attractive (as per step 2c para 8a) or is unlikely to be financially attractive (as per step 2c para 8b).

Sensitivity analysis of the Equity IRR to the Plant Load Factor (the most critical assumption) has been carried out considering a plant load factor of 20% (plant load factor as observed in recent past for other Enercon projects) and 23.97% (highest plant load factor achieved according to RERC, in its Order dated 29 September 2006). Plant Load Factor is the key variable encompassing variation in wind profile, variation in off-take (including grid availability) including machine downtime. The post tax Equity IRRs at the stated PLFs are as follows:

	PLF at 20%	PLF at 23.97%
Post tax Equity IRR without CER revenues	9%	14.8%
Post tax Equity IRR with CER revenues	11.3%	17.9%

As can be seen from above, the Project is not the most financially attractive (as per step 2c para 8a) we proceed to Step 4 (Common practice analysis).

**Step 4. Common practice analysis**

***Sub-step 4a. Analyze other activities similar to the proposed project activity:***



1. Provide an analysis of any other activities implemented previously or currently underway that are similar to the proposed project activity. Projects are considered similar if they are in the same country/region and/or rely on a broadly similar technology, are of a similar scale, and take place in a comparable environment with respect to regulatory framework, investment climate, access to technology, access to financing, etc. Other CDM project activities are not to be included in this analysis. Provide documented evidence and where relevant quantitative information. On the basis of that analysis, describe whether and to which extent similar activities have already diffused in the relevant region.

***Sub-step 4b. Discuss any similar options that are occurring:***

2. If similar activities are widely observed and commonly carried out, it calls into question the claim that the proposed project activity is financially unattractive (as contended in Step 2) or faces barriers (as contended in Step 3). Therefore, if similar activities are identified above, then it is necessary to demonstrate why the existence of these activities does not contradict the claim that the proposed project activity is financially unattractive or subject to barriers. This can be done by comparing the proposed project activity to the other similar activities, and pointing out and explaining essential distinctions between them that explain why the similar activities enjoyed certain benefits that rendered it financially attractive (e.g., subsidies or other financial flows) and which the proposed project activity can not use or did not face the barriers to which the proposed project activity is subject.
3. Essential distinctions may include a serious change in circumstances under which the proposed CDM project activity will be implemented when compared to circumstances under which similar projects were carried out. For example, new barriers may have arisen, or promotional policies may have ended, leading to a situation in which the proposed CDM project activity would not be implemented without the incentive provided by the CDM. The change must be fundamental and verifiable.

We analyze the extent to which wind energy projects have diffused in the electricity sector in Rajasthan. In 2005 – 06, electricity generation from wind sources was 417 GWh which is expected to increase to 512 GWh in 2006 – 07. This works out to 1.35% of total generation available to the state of Rajasthan in 2005 – 06 and 1.66% of total expected generation available to the state of Rajasthan in 2006 – 07. Clearly, electricity generation from wind is not a common practice in Rajasthan.

We analyze the wind energy projects in Rajasthan that have come under different policy regimes and in different years. Briefly, the various policies have progressively decreased the electricity tariffs payable by the offtaker (RRVPN/Discoms) and have progressively passed on burden of providing or paying for transmission facilities. Below is the electricity tariff payable under different policies:

Electricity tariff (Rs/kWh)	1999-00	2000-01	2001-02	2002-03	2003-04	2004-05	2005-06	2006-07	2007-08
1999 Policy	2.89	3.03	3.18	3.34	3.51	3.69	3.87	4.06	4.27
2000 Policy		3.03	3.18	3.34	3.51	3.68	3.87	4.06	4.26
2003 Policy					3.32	3.39	3.45	3.52	3.59
2004 Policy (Original)						2.91	2.96	3.01	3.06
2004 Policy (Amended)							3.25	3.31	3.37

Out of the 279 MW installed up to 31 March 2005, the wind power projects under various policies of Government of Rajasthan are set out below:

Policy 1999 (effective 11<sup>th</sup> March 1999): 4.25 MW



Policy 2000 (effective 4<sup>th</sup> Feb 2000): 82.23 MW  
Policy 2003 (effective 30<sup>th</sup> April 2003): 174.29 MW  
Policy 2004 (effective 25<sup>th</sup> October 2004): 18.85 MW

Currently, there are 134.71 MW of wind projects in Rajasthan (at various stages) that are in the CDM pipeline (on the [cdm.unfccc.int](http://cdm.unfccc.int) website) out of 279 MW and more projects are expected to come into the CDM pipeline.

With the revision of Policy 2004 (effective February 2006), the capacity additions during the three years are expected to be around 297 MW:

2005–06: 74 MW  
2006-07: 36 MW  
2007-08: 187 MW

Out of the 297 MW that is estimated to be installed up to 2008, this Project constitutes 60 MW. Enercon is further developing a 100 MW wind power project and another 24.8 MW as CDM project activities under the 2004 policy (amended). It is expected that other wind power projects during this period will be undertaken as CDM projects.

Clearly, wind power project development in Rajasthan is insignificant when compared to the power sector of Rajasthan. Further, wind power project development is substantially dependent on CDM mechanism and thus is not common practice.

***Sub-steps 4a and 4b are satisfied. The Project activity is additional***

**B.6. Emission reductions:**

**B.6.1. Explanation of methodological choices:**

>>

According to the approved baseline methodology ACM0002, the emission reductions **ER<sub>y</sub>** by the project activity during a given year “y<sup>1</sup>” is

$$ER_y = BE_y - PE_y - Ly \dots \dots \dots (1)$$

where *BE<sub>y</sub>* is the baseline emissions  
*PE<sub>y</sub>* is project activity emissions and;  
*Ly* is the amount of emissions leakage resulting from the project activity.

Baseline Emissions for the amount of electricity supplied by project activity, *BE<sub>y</sub>* is calculated as

$$BE_y = EG_y * EF_y \dots \dots \dots (2)$$

---

<sup>1</sup> Throughout the document, the suffix *y* denotes that such parameter is a function of the year *y*, thus to be monitored at least annually.



where  $EG_y$  is the electricity supplied to the grid,  $EF_y$  is the CO<sub>2</sub> emission factor of the grid as calculated below.

The emission factor  $EF_y$  of the grid is represented as a combination of the Operating Margin (OM) and the Build Margin (BM). Considering the emission factors for these two margins as  $EF_{OM,y}$  and  $EF_{BM,y}$ , then the  $EF_y$  is given by:

$$EF_y = w_{OM} * EF_{OM,y} + w_{BM} * EF_{BM,y} \dots \dots \dots (2)$$

with respective weight factors  $w_{OM}$  and  $w_{BM}$  (where  $w_{OM} + w_{BM} = 1$ ).

### The Operating Margin emission factor

As per ACM0002, dispatch data analysis should be the first methodological choice. However, this option is not selected because the information required to calculate OM based on dispatch data is not available in the public domain for the Northern electricity regional grid.

The Simple Operating Margin approach is appropriate to calculate the Operating Margin emission factor applicable in this case. As per ACM 0002 the Simple OM method can only be used where low cost must run resources constitute less than 50% of grid generation based on average of the five most recent years. The generation profile of the Northern grid in the last five years is as follows:

Generation in GWh	2004-05	2003-04	2002-03	2001-02	2000-01
<b>Low cost/must run sources</b>					
Hydro	36,128	38,279	30,335	29,129	29,020
Wind	332	15	25	19	6
Nuclear	7,503	7,380	8,800	8,158	6,669
<b>Other sources</b>					
Coal	106,156	103,232	100,362	96,882	92,417
Diesel	-	-	-	24	-
Gas	19,991	18,758	17,262	17,634	16,863
<b>Total Generation</b>	<b>170,109</b>	<b>167,663</b>	<b>156,785</b>	<b>151,845</b>	<b>144,975</b>
Low cost/must run sources	43,962	45,674	39,160	37,305	35,695
Low cost/must run sources	26%	27%	25%	25%	25%

Source: Table 3.4 of CEA General Review 2004-05, 2003-04, 2002-03, 2001-02, 2000-01

From the available information it is clear that low cost/must run sources account for less than 50% of the total generation in the Northern grid in the last five years. Hence the Simple OM method is appropriate to calculate the Operating Margin Emission factor applicable.

### Build Margin Emission Factor

The Build Margin emission factor  $EF_{BM,y}$  (tCO<sub>2</sub>/GWh) is given as the generation-weighted average emission factor of the selected representative set of recent power plants represented by the 5 most recent plants or the most recent 20% of the generating units built (summation is over such plants specified by k):



$$EF_{BM,y} = [\sum_i F_{i,m,y} * COEF_i] / [\sum_k GEN_{k,m,y}] \dots \dots \dots (5)$$

The summation over *i* and *k* is for the fuels and electricity generation of the plants in sample *m* mentioned above.

The choice of method for the sample plant is the most recent 20% of the generating units built as this represents a significantly larger set of plants, for a large regional electricity grid have a large number of power plants connected to it, and is therefore appropriate.

The Central Electricity Authority, Ministry of Power, Government of India has published a database of Carbon Dioxide Emission from the power sector in India based on detailed authenticated information obtained from all operating power stations in the country. This database i.e. The CO2 Baseline Database provides information about the Operating Margin and Build Margin Emission Factors of all the regional electricity grids in India. The Operating Margin in the CEA database is calculated ex ante using the Simple OM approach and the Build Margin is calculated ex ante based on 20% most recent capacity additions in the grid based on net generation as described in ACM0002. We have, therefore, used the Operating Margin and Build Margin data published in the CEA database, for calculating the Baseline Emission Factor.

**Combined Margin Emission Factor**

As already mentioned, baseline emission factor (EF<sub>y</sub>) of the grid is calculated as a combined margin (CM), calculated as the weighted average of the operating margin (OM) and build margin (BM) factor. In case of wind power projects default weights of 0.75 for EF<sub>OM</sub> and 0.25 for EF<sub>BM</sub> are applicable as per ACM0002. No alternate weights are proposed.

Using the values for operating margin and build margin emission factors provided in the CEA database and their respective weights for calculation of combined margin emission factor, the baseline carbon emission factor (CM) is 873.87 tCO<sub>2</sub>e/GWh or 0.87387 tCO<sub>2</sub>e/MWh.

**Project Emissions:**

The project activity uses wind power to generate electricity and hence the emissions from the project activity are taken as nil.

$$PE_y = 0$$

**Leakage:**

Emissions Leakage on account of the project activity is ignored in accordance with ACM0002.

$$L_y = 0$$

**B.6.2. Data and parameters that are available at validation:**

>>





<b>Data / Parameter:</b>	<i>EF<sub>OM,v</sub></i>						
Data unit:	tCO <sub>2</sub> e/MWh						
Description:	Operating Margin Emission Factor of Northern Regional Electricity Grid						
Source of data used:	“CO <sub>2</sub> Baseline Database for Indian Power Sector” published by the Central Electricity Authority, Ministry of Power, Government of India.  The “CO <sub>2</sub> Baseline Database for Indian Power Sector” is available at <a href="http://www.cea.nic.in">www.cea.nic.in</a>						
Value applied:	<table border="1"> <tr> <td>2002 – 03</td> <td>0.999 3</td> </tr> <tr> <td>2003 – 04</td> <td>0.986 9</td> </tr> <tr> <td>2004 – 05</td> <td>0.975 6</td> </tr> </table>	2002 – 03	0.999 3	2003 – 04	0.986 9	2004 – 05	0.975 6
2002 – 03	0.999 3						
2003 – 04	0.986 9						
2004 – 05	0.975 6						
Justification of the choice of data or description of measurement methods and procedures actually applied :	Operating Margin Emission Factor has been calculated by the Central Electricity Authority using the simple OM approach in accordance with ACM0002.						

<b>Data / Parameter:</b>	<i>EF<sub>BM,v</sub></i>
Data unit:	tCO <sub>2</sub> e/MWh
Description:	Build Margin Emission Factor of Northern Regional Electricity Grid
Source of data used:	“CO <sub>2</sub> Baseline Database for Indian Power Sector” published by the Central Electricity Authority, Ministry of Power, Government of India.  The “CO <sub>2</sub> Baseline Database for Indian Power Sector” is available at <a href="http://www.cea.nic.in">www.cea.nic.in</a>
Value applied:	0.5335
Justification of the choice of data or description of measurement methods and procedures actually applied :	Build Margin Emission Factor has been calculated by the Central Electricity Authority in accordance with ACM0002.
<b>B.6.3 Ex-ante calculation of emission reductions:</b>	

&gt;&gt;

Ex-ante calculation of emission reductions is equal to ex-ante calculation of baseline emissions as project emissions and leakage are nil.

Baseline emission factor (combined margin)  
= 873.87 tCO<sub>2</sub>e/GWh



## CDM – Executive Board

page 18

Annual electricity supplied to the grid by the Project  
 = 60 MW (Capacity) x 22% (PLF) x 8760 (hours) / 1000 GWh  
 = 115.632 GWh

Annual baseline emissions  
 = 873.87 tCO<sub>2</sub>e/GWh x 115.632 GWh  
 = 101,047 tCO<sub>2</sub>e

<b>B.6.4 Summary of the ex-ante estimation of emission reductions:</b>
--

&gt;&gt;

Year	Estimation of project activity emissions (tonnes of CO <sub>2</sub> e)	Estimation of baseline emissions (tonnes of CO <sub>2</sub> e)	Estimation of leakage (tonnes of CO <sub>2</sub> e)	Estimation of overall emission reductions (tonnes of CO <sub>2</sub> e)
15Aug2007-31Mar2008	0	63,154	0	63,154
01Apr2008-31Mar2009	0	101,047	0	101,047
01Apr2009-31Mar-2010	0	101,047	0	101,047
01Apr2010-31Mar2011	0	101,047	0	101,047
01Apr2011-31Mar2012	0	101,047	0	101,047
01Apr2012-31Mar2013	0	101,047	0	101,047
01Apr2013-31Mar2014	0	101,047	0	101,047
01Apr2014-31Mar2015	0	101,047	0	101,047
01Apr2015-31Mar2016	0	101,047	0	101,047
01Apr2016-31Mar2017	0	101,047	0	101,047
01Apr2017-14Aug2017	0	37,893	0	37,893
<b>Total (tonnes of CO<sub>2</sub>e)</b>	0	1,010,470	0	1,010,470

<b>B.7 Application of the monitoring methodology and description of the monitoring plan:</b>
--

<b>B.7.1 Data and parameters monitored:</b>
---

<b>Data / Parameter:</b>	EGy
--------------------------	-----



Data unit:	MWh (Mega-watt hour)
Description:	Net electricity supplied to the grid by the Project
Source of data to be used:	Electricity supplied to the grid as per the tariff invoices raised on RRVPNL/Jodhpur Discom.
Value of data applied for the purpose of calculating expected emission reductions in section B.5	Annual electricity supplied to the grid by the Project = 60 MW (Capacity) x 22% (PLF) x 8760 (hours) GWh = 115,632 MWh
Description of measurement methods and procedures to be applied:	Net electricity supplied to grid will be measured by a main meter (two way export import meter). The procedures for metering and meter reading will be as per the provisions of the power purchase agreement and the Metering Code of Rajasthan. Refer Annex – 4 for an illustration of the provisions for measurement methods.
QA/QC procedures to be applied:	QA/QC procedures will be as implemented by RRVPN/Jodhpur Discom pursuant to the provisions of the power purchase agreement and the Metering Code of Rajasthan and there will be no additional QA/QC procedures. Refer Annex – 4 for an illustration of the provisions for QA/QC procedures.
Any comment:	

### B.7.2 Description of the monitoring plan:

>>


Approved monitoring methodology ACM0002 / Version 06 Sectoral Scope: 1, “Consolidated monitoring methodology for zero-emissions grid-connected electricity generation from renewable sources”, by CDM - Meth Panel is proposed to be used to monitor the emission reductions.

This approved monitoring methodology requires monitoring of the following:

- Electricity generation from the project activity; and
- Operating margin emission factor and build margin emission factor of the grid, where *ex post* determination of grid emission factor has been chosen

Since the baseline methodology is based on *ex ante* determination of the baseline, the monitoring of operating margin emission factor and build margin emission factor is not required.

The sole parameter for monitoring is the electricity supplied to the grid. The Project is operated and managed by Enercon (India) Ltd. The operational and management structure implemented by Enercon is as follows:

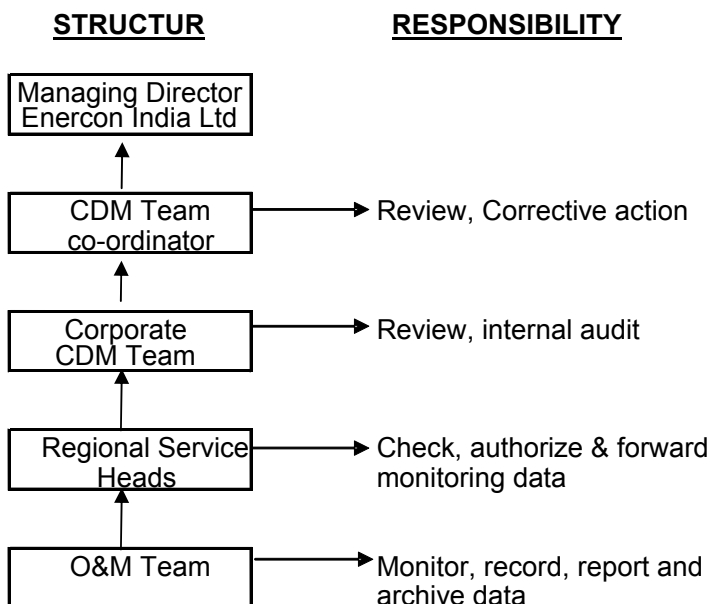**Training and maintenance:**

Training on the machine is an essential pre-requisite, to ensure necessary safety of man and machine. Further, in order to maximize the output from the Wind Energy Converters (WECs), it is extremely essential, that the engineers and technicians understand the machines and keep them in good health. In order to ensure, that Enercon's service staff is deft at handling technical snags on top of the turbine, the necessity of ensuring that they are capable of climbing the tower with absolute ease and comfort has been established. The Enercon Training Academy provides need-based training to meet the training requirements of Enercon projects. The training is contemporary, which results in imparting focused knowledge leading to value addition to the attitude and skills of all trainees. This ultimately leads to creativity in problem solving.

<b>B.8 Date of completion of the application of the baseline study and monitoring methodology and the name of the responsible person(s)/entity(ies)</b>
---

&gt;&gt;

Date of completion: 30/03/2007

Name of responsible person/entity:

PricewaterhouseCoopers Private Ltd (not a Project Participant)

<b>SECTION C. Duration of the <u>project activity</u> / <u>crediting period</u></b>
---

<b>C.1 Duration of the <u>project activity</u>:</b>
---

<b>C.1.1. <u>Starting date of the project activity</u>:</b>
---

&gt;&gt;



10/03/2006 being the date of placement of purchase order for the wind energy generators.

**C.1.2. Expected operational lifetime of the project activity:**

&gt;&gt;

20 years

**C.2 Choice of the crediting period and related information:****C.2.1. Renewable crediting period****C.2.1.1. Starting date of the first crediting period:**

&gt;&gt;

**C.2.1.2. Length of the first crediting period:**

&gt;&gt;

**C.2.2. Fixed crediting period:****C.2.2.1. Starting date:**

&gt;&gt;

01/11/2007, being the beginning of the month subsequent to the month in which the project is expected to be registered.

**C.2.2.2. Length:**

&gt;&gt;

10 years

**SECTION D. Environmental impacts**

&gt;&gt;

**D.1. Documentation on the analysis of the environmental impacts, including transboundary impacts:**

&gt;&gt;

Enercon appointed Aditya Environmental Services Private Limited to conduct rapid environmental impact assessment study to assess the impact of the project on the local environment.

Environmental Impact Assessment (EIA) of this project is not an essential regulatory requirement, as it is not covered under the categories as described in EIA Notification of 1994 or the Amended Notification of 2006. However, Enercon conducted the EIA to study impacts on the environment resulting from the project activity.

The EIA study included identification, prediction and evaluation of potential impacts of the CDM activities on air, water, noise, land, biological and socioeconomic environment within the study area. The ambient air concentrations of Suspended Particulate Matter, Respirable Particulate Matter, Oxides of Nitrogen, Sulphur dioxide and Carbon Monoxide were monitored and were found under limits as



specified by CPCB. The noise levels were observed through out the study period and were found to be in the permissible range. Water quality monitoring studies were carried out for determination of physico-chemical characteristics of bore wells. The ph level of water was found to be under the specified limits.

The study area represents part of Jaisalmer district, which is part of the Thar desert. The terrain is rough comprising sandy or stony wasteland & is very sparsely populated. The windfarm is located in the mist of the Indian ‘Thar’ Desert and does not come in the path of the migratory birds. There is no wild life or forestland near the project sites.

**D.2. If environmental impacts are considered significant by the project participants or the host Party, please provide conclusions and all references to support documentation of an environmental impact assessment undertaken in accordance with the procedures as required by the host Party:**

>>

EIA demonstrated that there is no major impact on the environment due to the installation and operation of the windmills. The desert ecology is not likely to get impacted by this type of project activity. The local population confirmed that there is no noise or dust nuisance due to windmills. The EIA also ruled out any adverse impacts due to the project activity.

**SECTION E. Stakeholders’ comments**

>>

**E.1. Brief description how comments by local stakeholders have been invited and compiled:**

>>

The comments from local stakeholders were invited through a local stakeholder meeting conducted at Gorbandh Palace, Jaisalmer on 18 September 2006. A local newspaper advertisement was placed in *Rajasthan Patrica* on 5<sup>th</sup> September 2006 inviting the local stakeholders for the meeting.

The local stakeholder consultation meeting had representatives from the nearby villages, representatives of Enercon and representative of Aditya Environmental Services (consultant to Enercon). The minutes of the meeting are set out in Appendix 2.

**E.2. Summary of the comments received:**

>>

The comments from local stakeholders covered the benefits the wind project activities have provided including employment opportunities to the local people, better transportation facilities to the near by towns, improved water availability, etc.

The local stakeholders did not find any negative impacts on account of the project activity on, inter alia, grazing by the cattle, affecting migratory patterns of the birds, noise levels, accidents, etc.

**E.3. Report on how due account was taken of any comments received:**

>>

Enercon provided the following responses in relation to the comments received from the local stakeholders:

- The benefits to the local stakeholders will be through employment opportunities provided by the project in terms of small shops and construction workers. It will also lead to better connectivity to nearby towns.



- The project does not affect the grazing by the cattle. Enercon does not use any kind for boundary wall to protect their machines and hence the accessibility of cattle to areas for grazing and drinking water is not affected.
- The Project does not fall under migratory patterns of the birds.
- Project has improved the availability of water, which can also be accessed from project site. The tube wells are located at a distance of 3 Km from project site which the people daily access.
- Enercon has appropriate protocols are in place to take care of all the safety issues. No incidence of accident has occurred.
- No noise disturbances have been observed so far and local inhabitation is far away from the project site.
- A school was reconstructed by Enercon India Limited in police lane in Jaisalmer, Rajasthan in 2004 – 05. Enercon will bear in mind the requirement of school in the village and opportunities for women in the village when it undertakes further developmental work.

The local stakeholders were satisfied with the explanations provided during the meeting.

**Annex 1****CONTACT INFORMATION ON PARTICIPANTS IN THE PROJECT ACTIVITY**

Organization:	Enercon (India) Limited
Street/P.O.Box:	A-9, Veera Industrial Estate, Veera Desai Road, Andheri West-400053
Building:	Enercon Tower
City:	Mumbai
State/Region:	Maharashtra
Postfix/ZIP:	400 053
Country:	India
Telephone:	+91-22-66924848
FAX:	+91-22-67040473
E-Mail:	a.raghavan@enerconindia.net
URL:	
Represented by:	
Title:	Associate Vice President
Salutation:	Mr.
Last Name:	A V Raghavan
Middle Name:	
First Name:	
Department:	Corporate
Mobile:	+91-98200 45724
Direct FAX:	+91-22-5692 1175
Direct tel:	+91-22-6692 4848 extn. 7169
Personal E-Mail:	a.raghavan@enerconindia.net

Organization:	Coöperatieve Centrale Raiffeisen-Boerenleenbank B.A. (trading as Rabobank International) ( <i>Rabobank</i> )
Street/P.O.Box:	One Queenhithe
Building:	Thames Court
City:	London
State/Region:	
Postfix/ZIP:	EC4V 3RL
Country:	United Kingdom
Telephone:	+44(0) 7664 9500
FAX:	
E-Mail:	
URL:	
Represented by:	Domenic Carratu
Title:	Managing Director
Salutation:	
Last Name:	Carratu
Middle Name:	
First Name:	Domenic





**CDM – Executive Board**

Department:	Global Financial Markets, Commodity & Weather Derivative Group
Mobile:	
Direct FAX:	+44(0)78093552
Direct tel:	+44(0)7664 9716
Personal E-Mail:	Domenic.Carratu@Rabobank.com



**Annex 2**

**INFORMATION REGARDING PUBLIC FUNDING**

**No ODA financing has been used in the Project activity.**

**Annex 3****BASELINE INFORMATION**

The Operating Margin data for the most recent three years and the Build Margin data for the Northern Region Electricity Grid as published in the CEA database are as follows:

**Simple Operating Margin**

	tCO <sub>2</sub> e/GWh
Simple Operating Margin - 2002-03	999.35
Simple Operating Margin - 2003-04	986.94
Simple Operating Margin - 2004-05	975.68
Average Operating Margin of last three years	987.32

**Build Margin**

	tCO <sub>2</sub> e/GWh
Build Margin	533.52

**Combined Margin calculations**

	Weights	tCO <sub>2</sub> e/GWh
Operating Margin	0.75	987.32
Build Margin	0.25	533.52
<b>Combined Margin</b>		<b>873.87</b>

Detailed information on calculation of Operating Margin Emission Factor and Build Margin Emission Factor is available at [www.cea.nic.in](http://www.cea.nic.in).




#### Annex 4

### MONITORING INFORMATION

- The electricity supplied to the grid will be metered at the 33/132/220 kV level at the RRVPN substation at Amarsagar. Representatives of RRVPN/Jodhpur Discom and Enercon will jointly take the main reading and sign the meter reading on the first day of every month. Simultaneously, the joint meter reading at the 33/132/220 kV level of the backup metering system at Amarsagar substation will also be taken by representatives of RRVPN/Jodhpur Discom and Enercon.
- The meters will jointly inspected/tested once in a year as per the terms of the PPA. Joint inspection and testing will also be carried out as and when difference in monthly meter readings exceeds the sum of maximum error as per accuracy class of main and back up meters.
- In case the meters are found to operate outside the permissible limits, the meters will be either replaced immediately or calibrated. Error correction will be applied to the meter reading. Whenever a main meter goes defective, the consumption recorded by the backup meter will be referred. The details of the malfunctioning along with date and time and snapshot parameters along with load survey will be retrieved from the main meter. The exact nature of the malfunctioning will be determined after analyzing the data so retrieved and the consumption recorded by the main meter will be assessed accordingly.
- If main as well as back up metering system becomes defective, the assessment of energy consumption for the outage period will be done from the backup meters by the concerned parties as mutually agreed or at the level of Metering Committee set up under the Metering Code.
- The main and the backup metering systems will be sealed in presence of representatives of Enercon and RRVPN/Jodhpur Discom.



**Appendix 1 – Location Map**

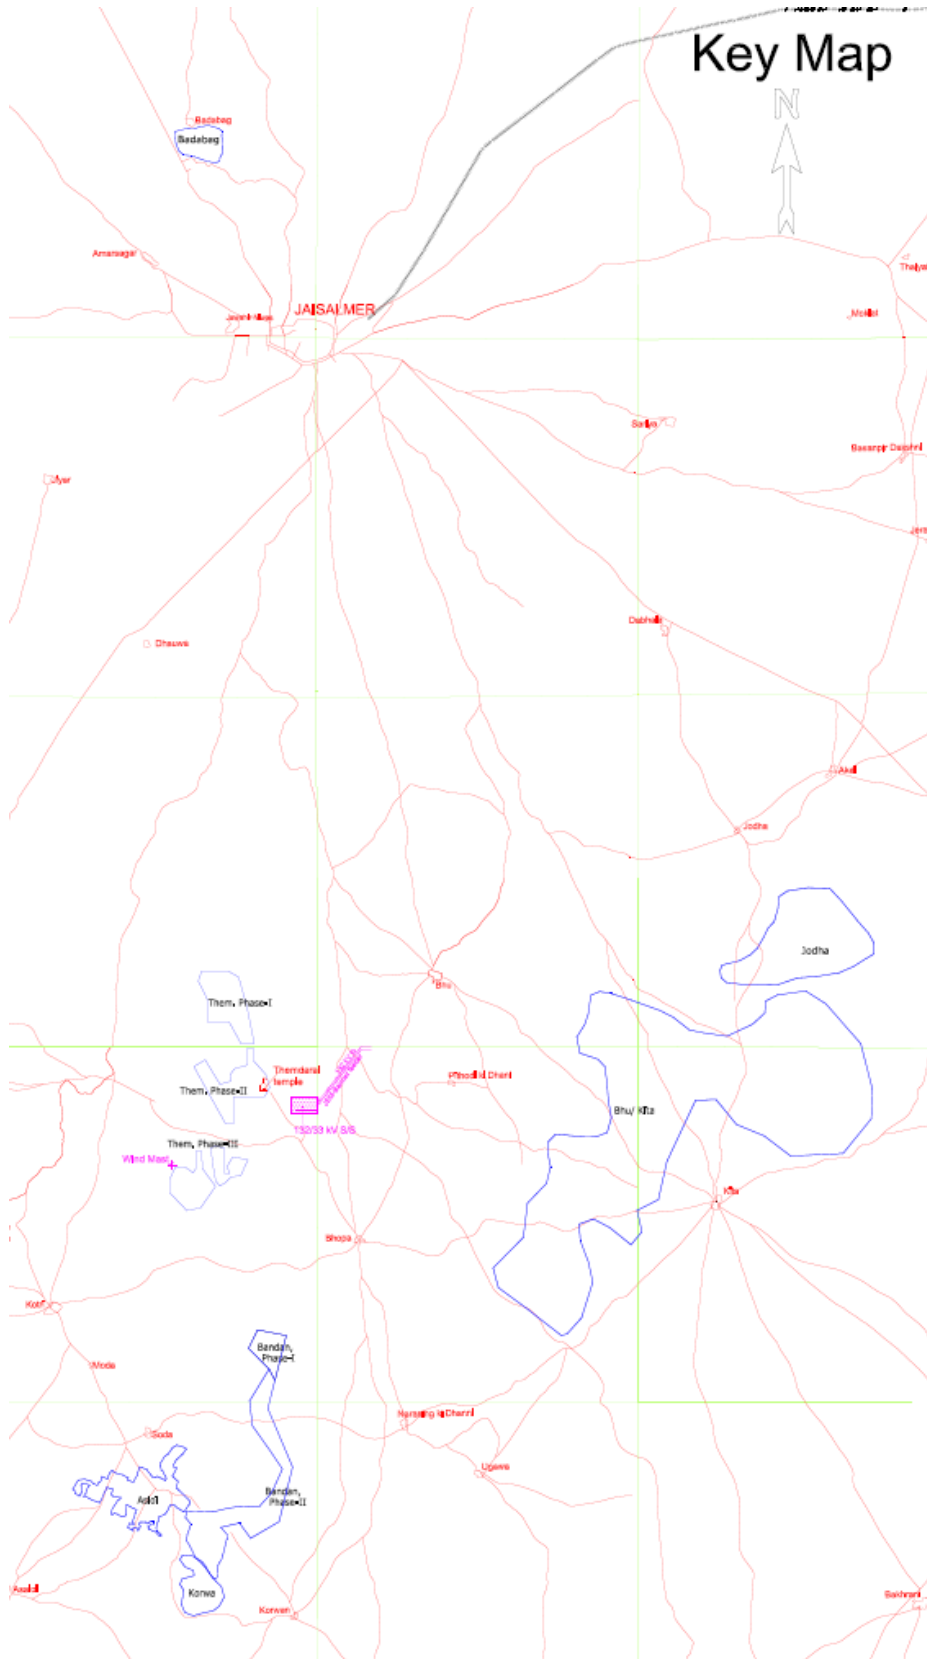

**Appendix 2 – Minutes of stakeholder consultation meeting**

<p><i>Public Consultation Meeting for Wind Energy Projects at Clean Development Mechanism Project of Enercon (India) Limited. situated at Kita. Bhu, Sodabhandhan ,Temderai(Phase I, PhaseII and PhaseIII), Asloi, Jodha, Korwa and Badabagh in Jaisalmer,Rajasthan</i></p> <p align="center"><b>Jaisalmer, District Rajasthan, India</b></p> <p align="center"><b>MINUTES OF THE MEETING</b></p>	
Venue: Gorbandh Palace, Jaisalmer	Date: 18 Sep 2006
The people participated are the following:	
Representatives:	
<p><b>Representatives from the Village:</b>          Shri. Rahim Singh          Shri. Punam Singh          Shri Kishan Singh          The list of all other people from the villages is annexed.</p> <p><b>Enercon (India) Limited:</b>          Mr. Anupam Mathur          Mr. Rajendra Vyas          Mr. Rakesh Chhangani          Mr. Dilip Sharma          Mr. Neeraj Gupta</p> <p><b>Aditya Environmental Services Pvt. Ltd.</b>          Mr. Gurmeet Singh</p>	
<p>Mr. Anupam Mathur invited Mr. Punam Singh, Ex- Sarpanch to chair the meeting.</p> <p>The agenda of the meeting is fixed as follows:          Welcome          Description of the project details          Queries and responses from the proponent and the stakeholders          Vote of thanks</p> <p align="center"><b>WELCOME ADDRESS</b></p> <p>Mr. Dilip Sharma, Security and Liasoning person from Enercon India Limited welcomed all the people who came to take part in the meeting. There were more than 20 people from all the villages that fall in the vicinity of the project sites.</p> <p><b>Description of the Project Details.</b>          The present stakeholder consultation is for 60 MW of Enercon Wind Farm Hindustan Limited and for 82.74 MW of the customer projects out of which 47.01 MW has been finalized and the rest 35.73 MW is in the process to be considered. Some the projects will also come up in addition to the finalised projects for CDM.          The Knowledge of the wind farm was communicated to the local people in the local language. The wind farm projects falls in the category of the renewable energy. The meaning of the renewable energy was explained. The sites where the projects are located have no commercial activity and is a waste land.          The best use of land is made through the project which otherwise was barren. Improved supply of electricity to the grid, and employment opportunities to local people. He explained function advantages of the windmill to the people. Self reliance on using renewable energy sources is</p>	



	<p>observed in Jaisalmer.</p> <p>The comparison between the wind farm projects and other alternatives is drawn in order to convey the advantages that wind power possess over other alternatives. The sites are located near Badabagh, Sodabandhan, Korwa, Asloi, Bhu, Temderai (Phase I, Phase II and Phase III) and Kita.</p> <p>In addition several other support services augmented by Enercon to local people in terms of transportation, mid –day meals to school children, renovation of Tamedarai temple etc. as its social community initiatives.</p> <p style="text-align: center;"><b>SPEECH BY MR. PUNAM SINGH</b></p> <p>The chairperson of the meeting briefed the advantages of the wind farm. The project has provided the employment opportunities to the local people as the result of which the income of the people have increased. He also praised Enercon India Limited for investing in district of Jaisalmer.</p> <p><b>Mr. Rahim Singh (BHU Sarpanch)</b></p> <p>The villagers in this part of the state are very backward but the times are changing with coming up of the wind farm projects of the Enercon India Limited. The project has provided the employment opportunities to the people. Security, drivers and labour people are selected among the local villagers.</p>
	<p><b>Mr. Gurmeet Singh</b>, Aditya Environmental Services briefed the environmental benefits of wind power generation as compared to that of thermal power generation based on coal. Similarly, a briefing on GHG and its role in global warming / increasing temperatures on the earth was given. The benefits in terms of pollution free environment and safeguard to human health were also communicated to the stakeholders while comparing coal-based generation to wind based generation. The Government of Rajasthan is also encouraging the development of renewable energy. Summary on Kyoto Protocol and CDM were made available.</p>

	<p>The concerns, suggestions, opinions of the stakeholders have been specially invited. The participants expressed the queries as given below. The representatives from ENERCON clarified them as given below.</p>	
	<b>Queries</b>	<b>Responses</b>
1.	<p>What are the benefits of the wind power projects the stakeholders have observed?</p>	<p>The project has provided the people with the employment opportunities. The project has given jobs and economic opportunities in terms of small shops and construction workers. The transportation facilities has improved and has increased their accessibility to the near by town.</p>
2.	<p>Has the project affected the grazing of local cattle?</p>	<p>No, the project does not affect the grazing by the cattle. Enercon India Limited does not use any kind for boundary wall to protect their machines and hence the accessibility of cattle to areas for grazing and drinking water is not affected.</p>
3.	<p>Has the project affected any migratory patterns of birds or fauna?</p>	<p>The project does not fall under migratory patterns of the birds. The major birds migrating in the region, but away from project site are “<i>Gatta</i>”, <i>Tilor</i>, and <i>Solan</i>, which usually take their path</p>



		away from the project site.
4.	Has the project affected the water availability? How far are the tube wells located from the site?	The project has improved the availability of water, which can also be accessed from project site. The tube wells are located at a distance of 3 Km from project site which the people daily access.
5.	During construction and erection has any incident of accident or damage occurred?	As to date no incidence of accident has occurred.
6.	Do Enercon take care of safety issues?	The Enercon India Limited takes care about the safety issues. Appropriate protocols are in place to take care of all the safety issues.
7.	Have you observed any noise disturbances from the project during construction and operation of the project has occurred by the local people?	No noise disturbances have been so far. Local inhabitation is far away from the project site.

**Women Representative**

The women representative asked if school could be provided for the education of the children. The school can provide the much need education to the children. Also, women should be provided with the good opportunities.

**Vote of thanks**

Mr. Dilip Sharma thanked all the people for sparing their time for this meeting and requested them to continue their support towards the projects of Enercon India Limited. The representatives of the villages and also the local population represented their happiness towards Enercon India Limited.